



PEAKMAX
FL28059.01-R1

24ga (min) **PEAKMAX** over 15/32" (min) plywood

Extreme Metal Fabricators
2160 SW Poma Dr | Palm City FL 34990

Product Description

Mechanical standing seam panel with 16" maximum coverage and a nominal rib height of 1.5"

Product Material

24ga (min) steel

Corrosion resistant per FBC 1507.4.3 where required

Fastener

#10 1-inch pancake style fastener, 2 or 4 per clip

Compliant with FBC 1506.6 where required.

Clip

26ga, 2" long fixed clip | 24ga, 6" long fixed clip

Substrate/Deck

15/32" (min) plywood or

3/4" (min) thick wood plank (min S.G. of 0.42)

Evaluated by:



David Eng, PE

Timberlake Cove, LLC

3324 W Univ Ave #206 | Gainesville FL

FL PE 81377 | FL CA 33344

www.TimberLakeCove.com

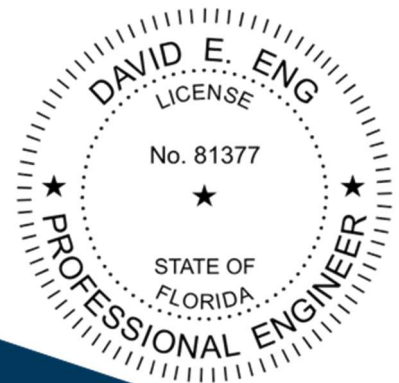

PEAKMAX

1½" MECHANICAL STANDING SEAM

This item has been digitally signed and sealed by D.E. Eng, PE, on the date indicated. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

Underlayment: Comply with local building code or FBC 1507.1.1 where required.

Slope: Comply with local building code or FBC 1507.4.2 where required.

Re-Roofing: This panel may be installed over a single layer of existing shingles as permitted by local building code or FBC 1511, provided the existing roof meets the conditions required by the applicable code.

Maximum Allowable Loads & Installation Requirements:

Method A: (2) #10 x 1" fasteners per 2" clip @ 16" o.c. and panel seamed to 90°: **118 PSF**

Method B: (2) #10 x 1" fasteners per 2" clip @ 8" o.c. and panel seamed to 90°: **135 PSF**

Method C: (4) #10 x 1" fasteners per 6" clip @ 10" o.c. and panel seamed to 180°: **191 PSF**

A factor of safety of 2 has been applied.

Technical Documentation:

This product has been tested to the UL 580 standard by Architectural Testing (now Intertek Testing, TST-1527), report D8985.01-450-18, as referenced in FL 17022.03-R7

Compliance Statement:

This product as described has demonstrated compliance with Florida Building Code 2020, 1504.3.2 (non-HVHZ), as required by FL Rule 61G20-3, method 1D.

This product as described has been tested and demonstrated compliance with:

- UL580 - Test for Uplift Resistance of Roof Assemblies
- UL 1897 - Uplift test for roof covering systems

Design Process:

The load tables in this report provides *one* prescriptive option for the fastening requirement for the applicable wind loads for roofs within the parameters described. For roofs outside of the listed parameters, design wind loads shall be determined as required by FBC 1609, ASCE 7, or other design code in force, using allowable stress. These load tables are based on ASCE 7-16.

Use of these tables assumes that the structure is:

- Enclosed and conforms to wind-borne debris provisions and is a regular shaped building
- Is not subject to across-wind loading, vortex shedding, or instability; nor does it have a site location for which channeling or buffeting warrant consideration

Engineering analysis may be completed by other licensed engineers for project specific approval by local authorities having jurisdiction.

Certification of Independence:

David Eng, PE and Timberlake Cove, LLC do not have, nor will acquire a financial interest in any company manufacturing or distributing products under this evaluation. The same entities do not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Exclusions and Limitations:

Design of deck and roof structure (to include attachment of plywood or wood plank) shall be completed by others. Fire classification and shear diaphragm design are outside the scope of this evaluation. Accelerated weathering/salt spray is outside the scope of this evaluation.

This report is limited to compliance with structural wind load requirements of FBC 1504.3.2, as required by Rule 61G20-3. Neither Timberlake Cove nor the manufacturer shall be responsible for any conclusions, interpretations, or designs made by others based on this evaluation report. This report is limited solely to documenting compliance with Rule 61G20-3, and makes no express or implied warranty regarding performance of this product. Installation shall be subject to the local building code and authority having jurisdiction; this report shall not be construed to supersede local codes in force.

Instructions:

Select the appropriate load table that applies to the structure in question.

Determine the design wind speed for the project location.

Use the attachment method indicated for that windspeed within each roof zone.


NOTE: ASCE 7-16 and FBC 2020 adopt a 7-zone concept. For the load tables below, the worst case was taken for each zone and reported using the standard zones 1-2-3:

Zone 1 includes zones 1 and 1'

Zone 2 includes zones 2e, 2r, and 2n


Zone 3 includes zones 3e and 3r

Combining these zones creates a clear, simple scheme, at the expense of some design efficiency. Contact the manufacturer for further information, or consult a licensed design professional.

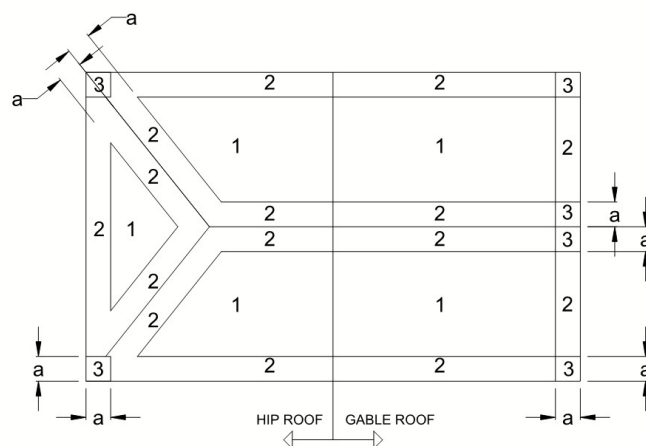


ROOF ZONES FOR GENERIC BUILDING


METHOD A

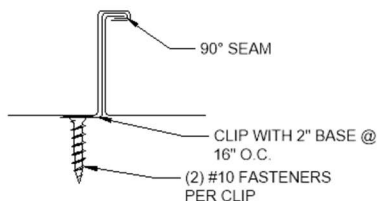

METHOD B

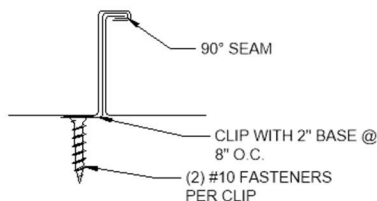

METHOD C

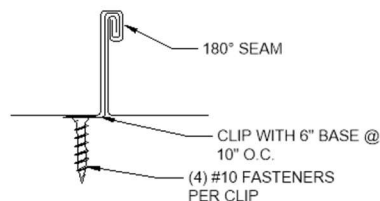

**NR: NOT RATED.
CONSULT DESIGN
PROFESSIONAL AS
NEEDED**

Use this load table for structures which meet the following criteria:

Are located in **Exposure B** area

Have either a **flat roof, or gable/hip roof with max slope of 12:12**

Have a mean Roof Height of **30 feet or less**

FL28059.01: 24ga PeakMax on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	A	A	A	A	A	A	A	A	A	A	A
Zone 2:	A	A	A	A	A	A	A	A	A	A	A
Zone 3:	A	A	A	A	A	A	A	A	A	B	C

Use this load table for structures which meet the following criteria:

Are located in **B, C, or D exposure** area

Have either a **flat roof, or gable/hip roof with max slope of 12:12**

Have a mean Roof Height of **30 feet or less**

FL28059.01: 24ga PeakMax on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	A	A	A	A	A	A	A	A	A	B	B
Zone 2:	A	A	A	A	A	A	B	C	C	C	NR
Zone 3:	A	A	A	A	A	B	C	C	C	NR	NR

Use this load table for structures which meet the following criteria:

Are located in **Exposure B** area

Have either a **flat roof less than 7°, hip roof with**

max slope of 12:12, or gable roof with slope between 4.4:12 & 12:12

Have a mean Roof Height of **30 feet or less**

FL28059.01: 24ga PeakMax on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	A	A	A	A	A	A	A	A	A	A	A
Zone 2:	A	A	A	A	A	A	A	A	A	A	A
Zone 3:	A	A	A	A	A	A	A	A	A	B	

Use this load table for structures which meet the following criteria:

Are located in **B, C, or D exposure** area

Have either a **flat roof less than 7°, hip roof with**

max slope of 12:12, or gable roof with slope between 4.4:12 & 12:12

Have a mean Roof Height of **30 feet or less**

FL28059.01: 24ga PeakMax on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	A	A	A	A	A	A	A	A	A	A	B
Zone 2:	A	A	A	A	A	A	A	B	B	C	C
Zone 3:	A	A	A	A	A	B	B	C	C	C	NR